



1262

TEST REPORT No : 1772-1461

DATE OF ISSUE : 9 July 2014

Page 1 of 10

BS EN ISO 354:2003
ACOUSTICS – MEASUREMENT OF SOUND ABSORPTION IN A
REVERBERATION ROOM

CLIENT:	GIK Acoustics Europe Unit A Perseverance Mills Giles Street Wibsey BD6 3HS
JOB NUMBER:	ACOUS/01772
MANUFACTURER:	GIK Acoustics Europe
MODEL:	“Spot Panels” Wall / Ceiling Panels
TYPE:	Type A Mounting
DATE RECEIVED:	6 May 2014
DATE OF TEST:	26 June 2014

Signed:.....

I G Rattigan
Laboratory Manager

Approved:.....

D J M^cCaul
Technical Manager

1 **TEST SAMPLES**


1.1 **Description of Test Samples**

Test Reference: **1772-1461**

Sample Reference: “Spot Panels”

Sample Description: Wall / ceiling panels each with dimensions of 600 mm wide × 1200 mm long × 56 mm deep and a measured average weight of 4.1 kg. The panel consisted of a timber frame containing a fibrous material panel. The face and edges of the panel were covered by a cloth face. Fifteen panels were arranged by the client in the centre of the floor of the reverberation room to create a single sample 10.86 m².

At the client’s request, the additional frequencies 40 Hz, 50 Hz, 63 Hz, 80 Hz, 6.3 kHz, 8 kHz and 10 kHz were measured. Tabulated data for these additional frequencies can be found in Appendix A.

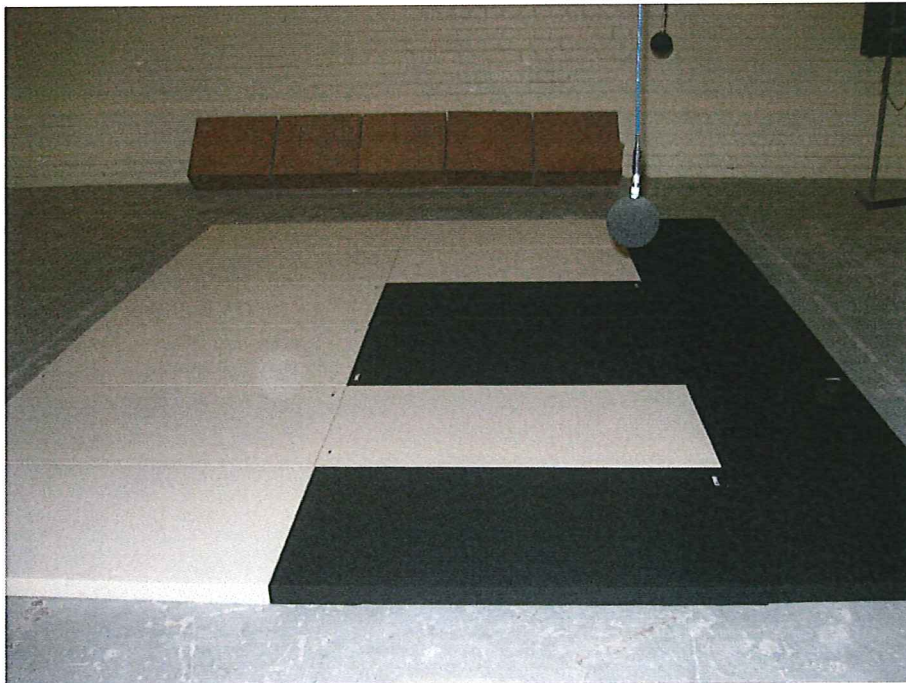

2 DESCRIPTION OF TEST PROCEDURE

2.1 Description of Test Facility

The tests were carried out in the large reverberation room at the University of Salford. The room has been designed with hard surfaces and non-parallel walls to give long empty room reverberation times with uniform decays. It has the shape of a truncated wedge. In addition 11 plywood panels, each panel 1.22m × 2.44m, were hung in the room to improve the diffusivity of the sound field. The test sample was placed in the centre of the floor. The excitation signal comprised wide band random noise played into the room via a loudspeaker system mounted in a cabinet facing a corner. The sound was monitored at each of 6 microphone positions. The room is 7.4m long × ~6.6m wide × 4.5m high with a volume of 220m³ and a total surface area of 224m². The volume of the room permits a maximum sample size of 12.79m² to be tested, in accordance with Clause 6.2.1.1 in BS EN ISO 354: 2003, "Acoustics - Measurement of sound absorption in a reverberation room".

2.2 Test Procedure

The procedure followed that detailed in BS EN ISO 354. Measurements were made on the rate of decay of sound in the test chamber with and without the sample in place. The frequency range from 100Hz to 5000Hz¹ was covered in one-third octave bands. An average reverberation time was taken from five decays at each of six microphone positions for each of two loudspeaker positions (i.e. 60 decays per third octave band). The decays were produced by exciting the room with amplified wide band random noise and stopping the excitation once the chamber became saturated. The time taken for the sound to decay by 20dB is measured and tripled to give the reverberation time. In practice this was determined by sampling the decaying sound field on a one-third octave band frequency analyser and storing the spectrum in a computer every 32 milliseconds. The reverberation time was obtained from the arithmetically averaged decays at each frequency. The measurements with and without the sample in the room were carried out consecutively to avoid significant changes in relative humidity and temperature that influence air absorption at higher frequencies.

¹ At the client's request, the measured frequency response was 40 Hz – 10,000Hz

2.3 Calculation

The random incidence sound absorption coefficients were determined from the measured data by means of the equations below:

$$\alpha_s = \frac{A_T}{S}$$

Where

α_s is the absorption coefficient of the sample

S is the area covered by the test specimen (m^2)

A_T is the equivalent sound absorption area of the test specimen (m^2)

$$A_T = A_2 - A_1 = 55.3V \left(\frac{1}{c_2 T_2} - \frac{1}{c_1 T_1} \right) - 4V(m_2 - m_1)$$

A_1 is the equivalent sound absorption area of the empty reverberation room (m^2).

A_2 is the equivalent sound absorption area of the room reverberation containing the test specimen (m^2).

V is the volume, in cubic metres, of the empty reverberation room:

c_1 is the propagation speed of sound at air temperature t_1 ;

c_2 is the propagation speed of sound at air temperature t_2 ;

T_1 is the mean reverberation times of the empty reverberation room in each frequency band (sec).

T_2 is the mean reverberation times of the reverberation room containing the test specimen in each frequency band (sec)

m_1 is the power attenuation, in reciprocal metres, using the climatic conditions that have been presented in the empty reverberation room.

m_2 is the power attenuation, in reciprocal metres, using the climatic conditions that have been presented in the reverberation room containing the test specimen.

The single-number rating, α_w , has been calculated in accordance with BS EN ISO 11654:1997.

(No correction is applied for the absorption of the surface covered by the test sample)

3 EQUIPMENT

	Departmental Record No
Norwegian Electronics 1/3 octave band real time analyser type 840 with in-built random noise generator	RTA2
Quad 510 power amplifier	PA7
2 of broadband loudspeakers (receiving room)	LS3-LS4
5 of Brüel & Kjær random incidence condenser microphone type 4166 in the receiving room	M7-M9 M18, M19
1 of G.R.A.S. random incidence condenser microphones type 40AP in the receiving room	M20
1 of Norsonic Multiplexers type 834A	MP2
HP Brio Pentium personal computer and related peripheral equipment (printer, plotter, monitor etc.)	COM6
Yamaha GQ1031BII graphic equalizer	GEQ1

4 RESULTS

The random incidence sound absorption coefficients are given in the table(s) overleaf.

Reverberation Room Volume:	220 m ²
Sample Size:	3612 × 3006 mm
Sample Thickness:	56 mm
Temperature Sample Out:	22.7 °C
Relative Humidity Sample Out:	45.6 %
Temperature Sample In:	22.7 °C
Relative Humidity Sample In:	44.5 %

The results here presented relate only to the items tested and described in this report.

BS EN ISO 354:2003						
Acoustics - Measurement of absorption in a reverberation room						
Client: GIK Acoustics Europe Unit A, Perseverance Mills Giles Street, Wibsey BD6 3HS						
Object: "Spot Panels" Wall / Ceiling Panels						
Size: 10.86 m ²						
Receiving room:						
Volume: 220 m ³						
Condition: clean						
Type: large reverberation room						
Location: acoustic transmission suite						
Sample out: Temperature [°C]: 22.7 Humidity [%]: 45.6						
Sample in: Temperature [°C]: 22.7 Humidity [%]: 44.5						
Sound absorption coefficient α_s						
Frequency Hz	α_s	T1 s	T2 s			
100	0.08	4.22	3.82			
125	0.29	4.03	2.97			
160	0.39	3.91	2.67			
200	0.62	3.50	2.10			
250	0.77	3.77	1.98			
315	0.87	4.21	1.97			
400	1.07	4.37	1.79			
500	1.11	4.66	1.80			
630	1.02	4.69	1.90			
800	1.02	4.68	1.89			
1000	1.05	4.54	1.84			
1250	1.02	4.34	1.84			
1600	0.99	4.02	1.80			
2000	0.97	3.70	1.76			
2500	1.02	3.28	1.61			
3150	0.99	2.83	1.52			
4000	1.01	2.32	1.34			
5000	0.99	1.84	1.17			
Test reference number: 1772-1461				Date: 26/06/14		
University of Salford, School of Computing, Science & Engineering						SSV1

<p>BS EN ISO 354:2003</p> <p>Acoustics - Measurement of absorption in a reverberation room</p>																																											
<p>Client: GIK Acoustics Europe Unit A, Perseverance Mills Giles Street, Wibsey BD6 3HS</p>																																											
<p>Object: "Spot Panels" Wall / Ceiling Panels</p>																																											
<p>Size: 10.86 m²</p>																																											
<p>Receiving room:</p> <p>Volume: 220 m³ Condition: clean Type: large reverberation room Location: acoustic transmission suite</p>																																											
<p>Sample out: Temperature [°C]: 22.7 Humidity [%]: 45.6 Sample in: Temperature [°C]: 22.7 Humidity [%]: 44.5</p>																																											
<p>Sound absorption coefficient α_s</p>																																											
<table border="1"> <thead> <tr> <th>Frequency Hz</th> <th>α_s</th> </tr> </thead> <tbody> <tr><td>100</td><td>0.08</td></tr> <tr><td>125</td><td>0.29</td></tr> <tr><td>160</td><td>0.39</td></tr> <tr><td>200</td><td>0.62</td></tr> <tr><td>250</td><td>0.77</td></tr> <tr><td>315</td><td>0.87</td></tr> <tr><td>400</td><td>1.07</td></tr> <tr><td>500</td><td>1.11</td></tr> <tr><td>630</td><td>1.02</td></tr> <tr><td>800</td><td>1.02</td></tr> <tr><td>1000</td><td>1.05</td></tr> <tr><td>1250</td><td>1.02</td></tr> <tr><td>1600</td><td>0.99</td></tr> <tr><td>2000</td><td>0.97</td></tr> <tr><td>2500</td><td>1.02</td></tr> <tr><td>3150</td><td>0.99</td></tr> <tr><td>4000</td><td>1.01</td></tr> <tr><td>5000</td><td>0.99</td></tr> <tr><td></td><td></td></tr> <tr><td></td><td></td></tr> </tbody> </table>	Frequency Hz	α_s	100	0.08	125	0.29	160	0.39	200	0.62	250	0.77	315	0.87	400	1.07	500	1.11	630	1.02	800	1.02	1000	1.05	1250	1.02	1600	0.99	2000	0.97	2500	1.02	3150	0.99	4000	1.01	5000	0.99					<p>sound absorption coefficient, α_s</p> <p>frequency, f (Hz)</p>
Frequency Hz	α_s																																										
100	0.08																																										
125	0.29																																										
160	0.39																																										
200	0.62																																										
250	0.77																																										
315	0.87																																										
400	1.07																																										
500	1.11																																										
630	1.02																																										
800	1.02																																										
1000	1.05																																										
1250	1.02																																										
1600	0.99																																										
2000	0.97																																										
2500	1.02																																										
3150	0.99																																										
4000	1.01																																										
5000	0.99																																										
<p>Test reference number: 1772-1461 Date: 26/06/14</p>																																											
<p>University of Salford, School of Computing, Science & Engineering SSV1</p>																																											

BS EN ISO 11654:1997							
Acoustics - Sound absorbers for use in buildings							
Rating of sound absorption							
Client:		GIK Acoustics Europe Unit A, Perseverance Mills Giles Street, Wibsey BD6 3HS					
Object:		"Spot Panels" Wall / Ceiling Panels					
Size:		10.86 m ²					
Receiving room:		Volume: 220 m ³ Condition: clean Type: large reverberation room Location: acoustic transmission suite					
Sample out:		Temperature [°C]: 22.7		Humidity [%]: 45.6			
Sample in:		Temperature [°C]: 22.7		Humidity [%]: 44.5			
α_w		=		1.00			
Classification:		A					
If a shape indicator is given, it is strongly recommended to use this single-number rating in combination with the complete absorption coefficient curve that can be obtained on request.							
Frequency	α_s	α_p					
Hz							
100	0.08						
125	0.29	0.25					
160	0.39						
200	0.62						
250	0.77	0.75					
315	0.87						
400	1.07						
500	1.11	1.00					
630	1.02						
800	1.02						
1000	1.05	1.00					
1250	1.02						
1600	0.99						
2000	0.97	1.00					
2500	1.02						
3150	0.99						
4000	1.01	1.00					
5000	0.99						
Test reference number: 1772-1461				Date: 26/06/14			
University of Salford, School of Computing, Science & Engineering						SSV1	

APPENDIX A

At the client's request, the following additional frequencies were measured.

Frequency [Hz]	α	T_1 [s]	T_2 [s]
40	0.04	9.23	8.48
50	0.02	7.89	7.56
63	0.01	5.81	5.63
80	0.07	5.65	4.98
6,300	1.00	1.62	1.07
8,000	1.10	1.17	0.83
10,000	1.02	0.83	0.65
